

### Contents

1. Factory default settings
2. Specification & wiring
3. Mounting
4. Installation
5. Wiring diagram
6. Frost protection
7. Button / symbol description
8. Resetting the thermostat
9. Keypad lock and unlock
10. High and Low temperature limitation
11. Adjusting the switching differential
12. Adjusting the setpoint temperature
13. Changing the thermostat mode
14. Normal control mode (On / Off)
15. Delay start control mode
16. Replacing the batteries



**CAUTION!**

Before commencing any work on the electrical connections, you must first disconnect the thermostat from the mains. None of the 230V connections must be live until the installation has been completed and the housing is closed. Only qualified electricians or authorised service staff are permitted to open the thermostat.

There are parts that may carry mains voltage behind the cover. The thermostat must not be left unsupervised when open. (Prevent non specialists and especially children from gaining access to it.)

*Important: Keep this document*

Prior to setting the thermostat, it is necessary to complete all required settings described in this section.

## 1. Factory default settings



Contacts:	Volt Free
Temperature indicator:	°C
Switching differential:	0.4°C
In built frost protection:	5°C
High and Low temp. limitation:	Off

## 2. Specifications & wiring

Power supply:	2xAA Alkaline Battery
Power consumption:	2mW
Battery replacement:	Once per year
Temp. control range:	5 ... 35°C
Ambient temperature:	0 ... 50°C
Contact rating:	8A 250Vac
Dimensions:	84 x 84 x 30mm
Temperature sensor:	NTC 10K Ohm @ 25°C
Temperature indication:	°C
Switching differential:	Adjustable from 0.2/0.4/0.6/0.8/1.0°C
Frost protection:	Only operational in stand by mode

## 3. Mounting


- The mounting height should be 1.5 meters above the floor level.  
 The thermostat should be wall mounted in the room where the heating is to be controlled.  
 The place of installation should be chosen so that the sensor can measure the room temperature as accurately as possible.  
 Choose the mounting location to prevent direct exposure to sunlight or other heating / cooling sources when mounted.  
 The unit can be fitted to:
1. Recessed conduit boxes
  2. Surface mounting boxes
  3. Directly on walls.

## 4. Installation

- Slacken the fastening screw on the bottom of the thermostat with a philips head screwdriver.  
 The thermostat is hinged and can be opened 180 degrees.  
**Mount the unit as described in section 3.**  
 Wire the thermostat according to the wiring diagram.  
 Close the thermostat and tighten the fastening screw.

## 5. Wiring diagram

INTERNAL WIRING DIAGRAM CRT2



## 6. Frost protection



5°C

Frost protection is built into this thermostat, it is pre fixed at 5°C and is not adjustable.  
 It will only be activated when the thermostat is in the stand by mode and the room temperature reaches 5°C.

## 7. Button / Symbol description



## 8. Resetting the thermostat

- It is necessary to reset the thermostat prior to initial programming.  
 Press and hold the **Set** button for 5 seconds.  
 dEL will appear on the screen.  
 Press the **RESET** button on the side of the thermostat.

## 9. Keypad lock and unlock



OFF


- To lock the keypad, press and hold the **On** and **Off** buttons for 10 seconds.  
 will appear on the screen. The keypad is now locked.  
 To unlock the keypad, press and hold the **On** and **Off** buttons for 10 seconds.  
 will disappear from the screen. The keypad is now unlocked.



### 10. High and Low temperature limitation OFF


An upper and lower temperature limit may be chosen.  
Press and hold the  and  buttons for 10 seconds.



**Limit ON** will appear on the screen.


Use the  button to select **Limit ON**.

Press the  button to select high limit.

Press the  and  buttons to select high limit temperature.

Press the  button to select low limit.

Press the  and  buttons to select low limit temperature.


Press the  button and the thermostat is ready for operation.

**Limit** will appear on the screen.


To deactivate High and Low temperature limitation.

Press and hold the  and  buttons for 10 seconds.

**Limit ON** will appear on the screen.

Use the  button to deactivate this function.

**Limit OFF** will appear on the screen.


Press the  button and the thermostat is ready for operation.

### 11. Adjusting the switching differential (Normal + DS)



Press the  button once, Diff set will appear on the screen.

The factory default switching differential of 0.4°C will appear on the screen.


Press the  and  buttons to select the desired differential from 0.2 - 1°C.

Press the  button to return to normal operation.

### 12. Adjusting the setpoint temperature

Press the  or  buttons to adjust the temperature setpoint.



### 13. Changing the thermostat mode

P<sub>0</sub> - Normal On/Off mode 

P<sub>1</sub> - Delay Start mode

Press the 'Reset' button at the side of the thermostat.

P<sub>0</sub> will appear on the screen.


Use the  or  buttons to change between P<sub>0</sub> and P<sub>1</sub>.


Select P<sub>0</sub> for normal operation.


Select P<sub>1</sub> for delay start.

Press the  'standby' button to confirm.

### 14. Normal control mode (On/Off)


When the temperature falls below the setpoint temperature, the flame symbol  will appear and the thermostat will switch on.


When the temperature rises above the setpoint temperature, the flame symbol  will disappear and the thermostat will switch off.

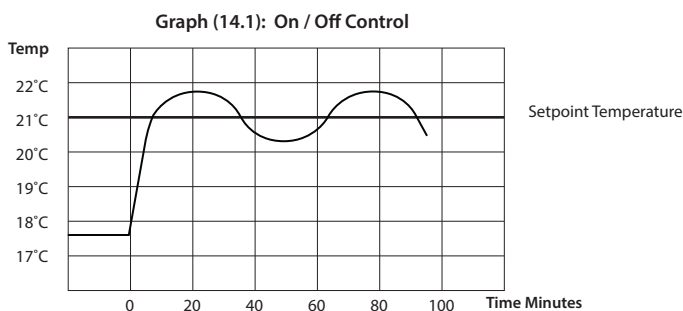


### 15. Delay start control mode

Delay start is an energy saving mode.


When the delay start function is active the  symbol will appear on the screen. When in this mode the activation of the thermostat is delayed by a variable time depending on the current temperature, setpoint temperature and also the fall in temperature from when the delay start has activated. See graph (15.1) Delay Start Control.

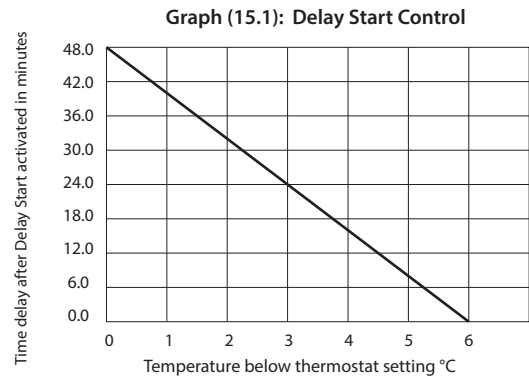

The  symbol will show until the thermostat activates.

When activated the thermostat will allow the heating system time to reach the setpoint and delay start will remain inactive until it reaches this setpoint.

**Delay start can be reactivated by:**

Lowering the setpoint below the current temperature, pressing the  'standby' button to set the temperature, then raising the setpoint above the zone temperature within 6°C of the setpoint.

The heating will be delayed as per the line on the graph.

If the difference between the actual temperature and the setpoint is 1°C the thermostat will delay starting for circa 40 minutes.

If the difference between the actual temperature and the setpoint is 3°C the thermostat will delay starting for circa 24 minutes.

If the difference is 6°C or more, the heating will be switched on immediately.

The time delay will change if the temperature drops from the original calculation.

To deactivate Delay Start, see section 13.

### 16. Replacing the batteries

Slacken the fastening screw on the bottom of the thermostat with a philips head screwdriver.

The thermostat is hinged and can be opened 180 degrees.

Replace the batteries with 2 x AA Alkaline batteries.

Close the thermostat and tighten the fastening screw.

