



### Important: Keep this document

The V22\_P and V2\_FP range of motorised valves are specifically designed for use in domestic applications only.

They are not designed for use in commercial or industrial applications such as schools, nursing homes or hotels where large commercial pump sets are fitted.



**Warranty will be void if a valve is fitted in any application other than domestic.**

Please note we have a full range of commercial and industrial valves to suit every application.

**CAUTION!** Installation and connection should only be carried out by a qualified person and in accordance with wiring regulations.

- Do not open the products. There are no serviceable or adjustable parts inside. The system must be fused to no more than 3 Amps.
- Isolate mains supply before installation commences.
- Isolate mains supply before attaching cable to actuator.
- Isolate mains supply before detaching cable from actuator.
- If this equipment is installed or used in a way not specified by the manufacturer, its safety may be impaired.

## Product Drawing

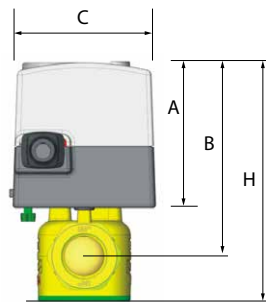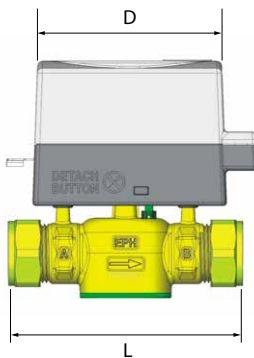

| VALVE TYPE        | L   | H   | A  | B  | C  | D  |
|-------------------|-----|-----|----|----|----|----|
| 3/4" Compression  | 113 | 111 | 70 | 93 | 68 | 93 |
| 22mm Compression  | 113 | 101 | 70 | 93 | 68 | 93 |
| 28mm Compression  | 124 | 114 | 70 | 93 | 68 | 93 |
| 3/4" Female BSP   | 89  | 111 | 70 | 93 | 68 | 93 |
| 1" Female BSP     | 93  | 114 | 70 | 93 | 68 | 93 |
| 1 1/4" Female BSP | 105 | 127 | 70 | 93 | 68 | 93 |

# INSTALLATION & OPERATING INSTRUCTIONS

## 1. Valve positioning

Install the valve so the actuator head is not below the horizontal level of the pipework. The open vent and cold feed must not be isolated. The flow must be in the direction of the arrow. (A to B).

## 2. Fitting the valve body to the pipework

### 2.1 Compression connection

Fit the valve body using the nuts and olives provided. When tightening the compression nuts ensure that only the valve body is used for grip. Take care not to overtighten. The actuator should not be mounted when fitting the valve.

### 2.2 BSP connection

Fit the valve body to the pipework via the BSP threaded connections. The actuator should not be mounted when fitting the valve.

## 3. Removal of actuator from the valve body

To remove the actuator head from the valve body ensure that the manual override lever is in the manual position. Ensure that the fixing screw located under the detach button is loosened and then press the detach button. The actuator will detach from the valve body.

## 4. Fitting of actuator to the valve body

Before fitting the actuator, please ensure that the manual override lever is in the raised manual position and the fixing screw is loosened. The actuator is mounted by aligning the 4mm flat spindle on the valve body to the identically sized slot on the actuator. When the valve and actuator are successfully coupled, the actuator locking mechanism will "click" into place. Now tighten the fixing screw located under the detach button.

Once the valve is fitted, place the manual override lever in the raised manual position. It is now possible to flush and drain the system to remove any foreign matter. The system can now be refilled and corrosion inhibitor may be added if required.

## 5. Wiring Connections

### 5.1 The 1.2 metre cable can be connected as follows:


| WIRE COLOUR    | DESCRIPTION  |
|----------------|--|
| Brown          | 230V live (normally connected via room or cylinder stat)     |
| Blue           | Neutral supply   |
| White          | Auxiliary switch N/C   |
| Grey           | Auxiliary switch N/O (normally connected to Boiler and Pump) |
| Orange         | Auxiliary switch COM (normally connected to 230V)            |
| Yellow / Green | Earth connection   |

### CAUTION!


- Ensure that no more than a 3A fuse is used to supply all controls.
- Electrical installation must conform with current I.E.E. regulations.

## 5.2 Diagram:

**V221P / V222P / V222PW / V222FP**

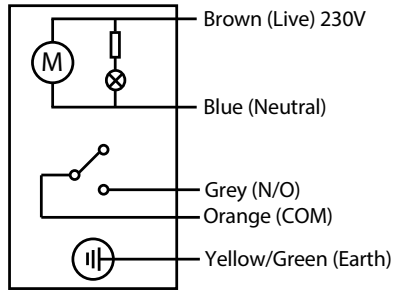

**V228P / V228PW / V228FP / V232FP**

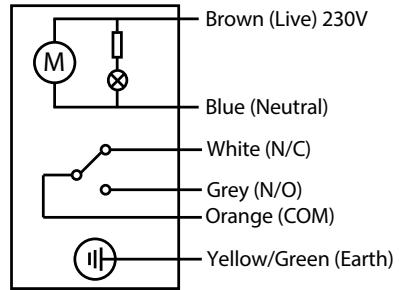

The auxiliary switch can be used as an interlock facility, thereby ensuring any auxiliary equipment is switched OFF when the valve is in the closed position. When the valve is in the fully open position the auxiliary equipment will be switched ON.\*

## 6. Commissioning

Once the system has been filled and vented, carry out the following to ensure correct operation of the valve.

- A) Ensure the manual override lever is in the Auto position.
- B) Switch on the relevant channel on the programmer.
- C) Set the thermostat to maximum.
- D) The valve should move to the fully open position.
- E) The auxiliary switch should close and thereby switch ON any auxiliary equipment.\*

Once satisfied with valve operation. Reset the programmer and thermostat to normal operating conditions.

\* Examples of auxiliary equipment include boilers and pumps

## WARNING!

- Under no circumstances should the actuator be insulated or covered by any other material.
- Lack of ventilation will cause the actuator to heat up beyond the maximum permissible ambient temperature of 50°C.

# TECHNICAL SPECIFICATION

| MODEL  | COMPRESSION | FEMALE BSP | Kvs(m <sup>3</sup> /h) | MAX CLOSE OFF PRESSURE (BAR) |
|--------|-------------|------------|------------------------|------------------------------|
| V221P  | 3/4"        | -          | 4.6                    | 1.0                          |
| V222P  | 22 mm       | -          | 4.6                    | 1.0                          |
| V228P  | 28 mm       | -          | 6.8                    | 0.6                          |
| V222FP | -           | 3/4"       | 4.6                    | 1.0                          |
| V228FP | -           | 1"         | 6.8                    | 0.6                          |
| V232FP | -           | 1 1/4"     | 8.0                    | 0.3                          |

| ACTUATOR                  |        | VALVE                           |             |
|---------------------------|--------|---------------------------------|-------------|
| Motor supply voltage      | 230V   | Max. static pressure            | 21 Bar      |
| Rated impulse voltage     | 2500V  | Max. operating pressure         | 21 Bar      |
| Power consumption         | 5W     | Permenant operating temperature | 2 ... 88 °C |
| Max. ambient temperature  | 50 °C  |                                 |             |
| Protection rating         | IP20   |                                 |             |
| Auxiliary switch rating   | 11(3)A |                                 |             |
| Impedance protected motor |        |                                 |             |

|                           |  |
|---------------------------|--|
| <b>LEAD SUPPLIED</b>      | 1.2 metre cable. Earth Connection required.  |
| <b>ACTUATOR OPERATION</b> | 230V Power to open - Spring return to close.   |
|                           | This is not a fail safe, a no fail or a safety product.  |
|                           | This control is designated Type 1. AA. C in accordance with EN60730.   |
| <b>MANUAL OVERRIDE</b>    | Type of action is multi position. Type of movement is rotary.  |
|                           | Valve may be manually opened for filling or draining the system.   |
|                           | In normal operation, the lever must be in the Auto position  |
|                           | If the mains power is disconnected, the valve will automatically spring return to the closed position (Port A) |

## WARNING!

- Under no circumstances should the actuator be insulated or covered by any other material.
- Lack of ventilation will cause the actuator to heat up beyond the maximum permissible ambient temperature of 50°C.

The crossed out wheelee bin symbol on this product indicates that this product must not be disposed of in your general waste. It can be taken to your Local Authority Civic Amenity site for free or returned to your retailer for free when you are buying a replacement. Inappropriate waste handling could lead to negative effects on the environment and human health. With your cooperation you contribute to the correct disposal, reuse, recycling and recovery of the components of this product and the protection of the environment.



### EPH Controls IE

T 021 471 8440  
 technical@ephcontrols.com  
 www.ephcontrols.com

### EPH Controls UK

T 01933 322 072  
 technical@ephcontrols.co.uk  
 www.ephcontrols.co.uk