RFC - RF Cylinder Thermostat

Installation Instructions

For use in normal environments.

CAUTION! Installation and connection should only be carried out by a qualified person and in accordance with national wiring regulations.

- If this device is used in a way not specified by the manufacturer, it's safety may be impaired.
- Ensure that this wireless enabled thermostat is installed 1 metre from any metallic object, television, radio or wireless internet transmitter.


This thermostat can be mounted in the following ways:

- To a recessed conduit box
- To a surface mounted box
- Directly mounted on wall




Important: Keep this document


1

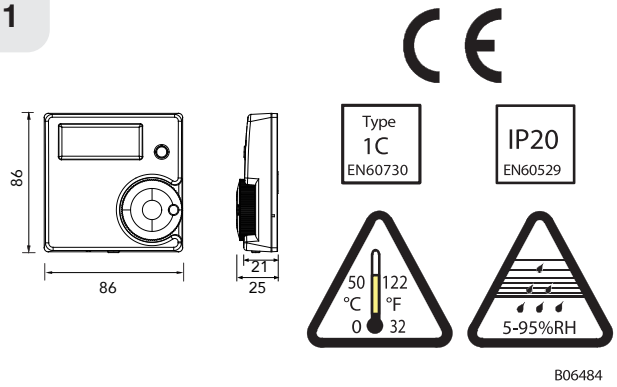

2

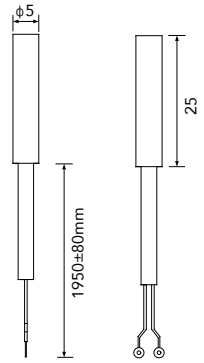


3

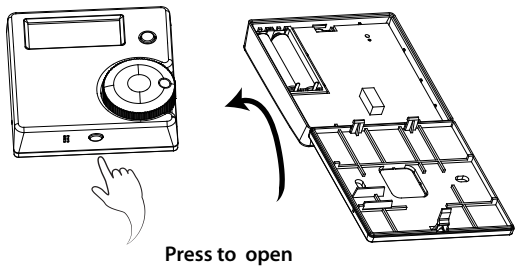


Press to open


4

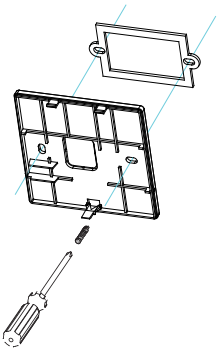

5

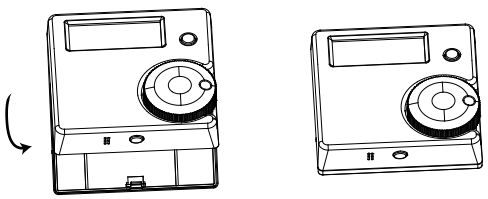

6

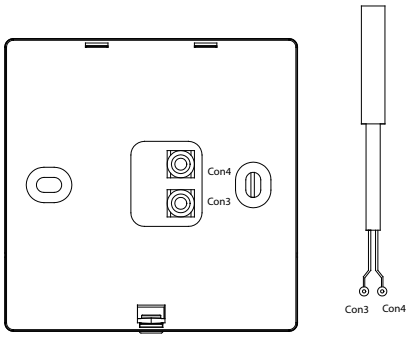

EPH Controls Ireland
021 471 8440
technical@ephcontrols.com
Cork, T12 F753
www.ephcontrols.com

EPH Controls UK
01933 322 072
technical@ephcontrols.co.uk
Harrow, HA1 1BD
www.ephcontrols.co.uk