TA2_ Thermal Actuator

Installation Instructions

For use in normal environments.

CAUTION! Do not use if cable is defective.

- Disconnect the power supply from any defective appliances.
- Factory setting is (NC) Normally Closed.
- Guidelines for the electrician; Level of contamination 2; As per EN60730.
- When changing from normally closed to normally open, live components are exposed. Therefore, disconnect the power when changing.

1

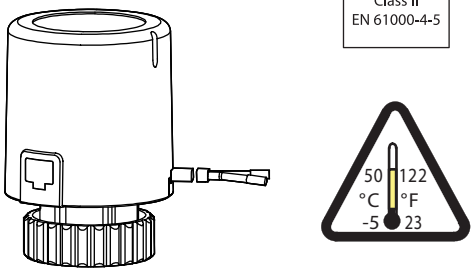

2

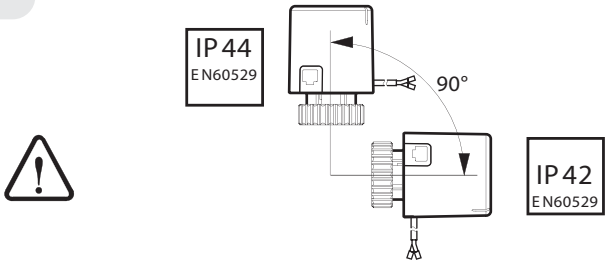

3

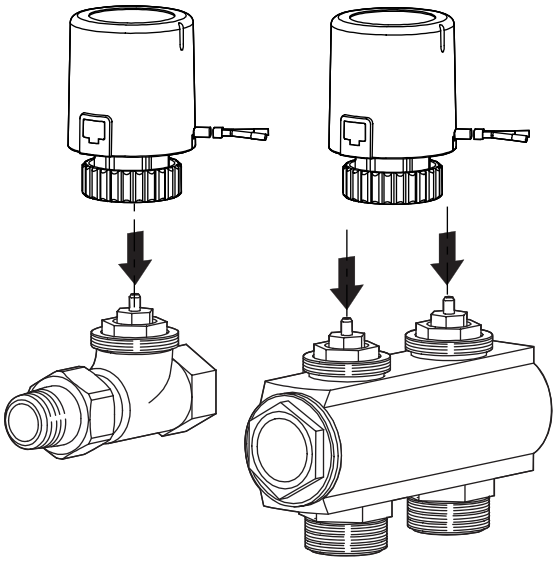

4

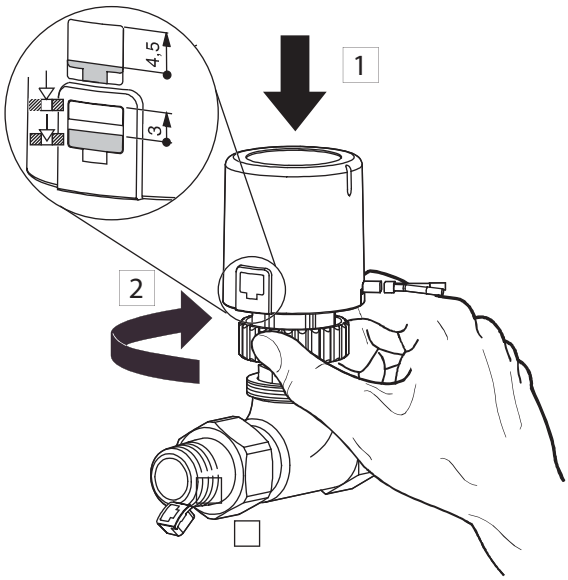

5

TA230 - 230Vac
TA24 - 24Vac

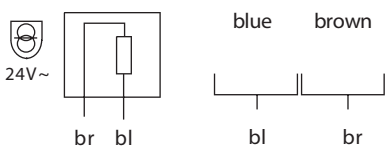

	TA230	TA24
Voltage	230 V~	24 V~
Running time	3,5 min.	4,5 min.
Stroke	3,5 mm	3,5 mm
Spring pressure	125 N	125 N
Power consumption	2,5 W	3 W
Inrush Current	<550 mA (max. 100ms)	<1400 mA (max. 2mins)
Operating Current	<150 mA	<300 mA

EPH CONTROLS

EPH Controls Ireland
021 471 8440
technical@ephcontrols.com
Cork, T12 W665
www.ephcontrols.com

EPH Controls UK
01933 322 072
technical@ephcontrols.co.uk
Harrow, HA1 1BD
www.ephcontrols.co.uk

Installation Instructions

For use in normal environments.

6



To set to (NO) Normally Open

6.1

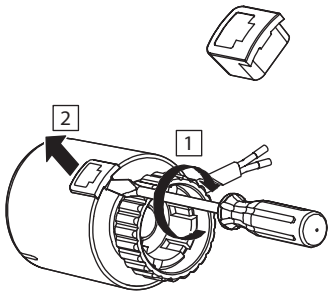

6.2

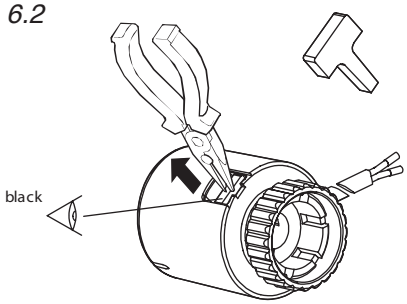

6.3

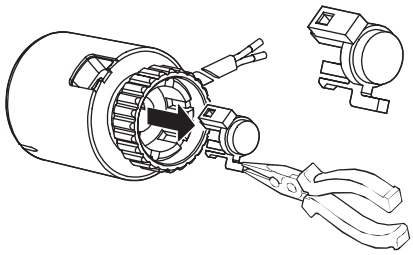

6.4

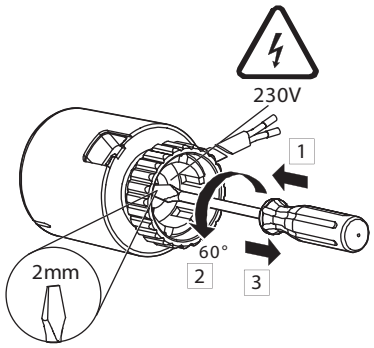

6.5



6.6

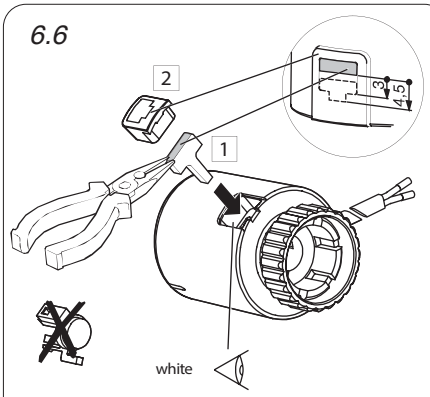

7



To reset to (NC) Normally Closed

7.1



7.2



7.3



7.4

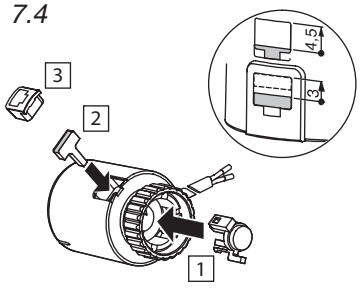

EPH Controls Ireland
021 471 8440
technical@ephcontrols.com
Cork, T12 W665
www.ephcontrols.com

EPH Controls UK
01933 322 072
technical@ephcontrols.co.uk
Harrow, HA1 1BD
www.ephcontrols.co.uk