

CDT2-RF



Mains RF Room Thermostat
Installation and Operation Guide

Table of contents

Installation Instructions

Factory Default Settings	2
Specifications	3
LCD Display	4
Buttons	5
Wiring	6
Mounting & Installation	7

Operating Instructions

On / Off Function	11	
Adjusting the Target Temperature	11	
Locking the Keypad	11	
Backlight	12	
Menu	P0 1 Connecting a CDT2-RF	12
	P0 2 Operating Mode (Normal/Delay Start/TPI)	15
	P0 3 Setting High and Low limits	22
	P0 4 HYS - Hysteresis	23
	P0 5 Calibrate	24
	P0 6 Setback Mode	25
	P0 7 AFS - Air / Floor Sensor	26
	P0 8 FHL - Floor High Limit	28
Resetting the Thermostat	29	



Mains RF Room Thermostat
Installation Instructions

Factory Default Settings




Temperature indicator:	°C
Keypad lock:	Off
Backlight:	Auto
Operating mode:	Normal
High and low Limits:	OFF
Hysteresis:	0.4°C
Setback temperature:	0°C
AFS - Air/Floor/Sensor:	01 Internal Air Sensor
FHL - Floor High Limit:	26°C


Specifications

Power supply / Input:	230VAC
Power consumption:	1.1W
Temperature range:	5...35°C
Ambient temperature:	0...45°C
Ambient admissible humidity:	5-95% RH
Dimensions:	91 x 91 x 26mm
Internal temperature sensor:	NTC 100K
Backlight:	White
IP rating:	IP20
Pollution degree:	2
Hysteresis (Switching differential):	Adjustable from 0 to 1°C 0.1°C increments
Automatic action:	1C
Setback temperature:	Adjustable 0°C to 10°C


LCD Display

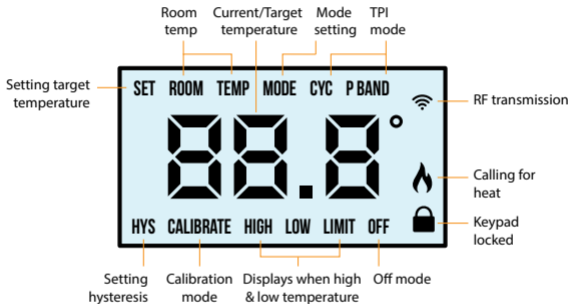

Buttons

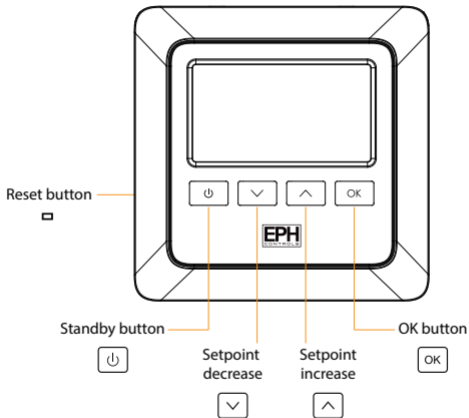

Wiring



Terminal Connections

N	Neutral In
L	Live In
2 & 3	External Temperature Sensor

Note: NTC10K temperature sensor can be bought separately as an accessory.

Mounting & Installation

Caution!

- Installation and connection should only be carried out by a qualified person.
- Only qualified electricians or authorised service staff are permitted to open the thermostat.
- If the thermostat is used in a way not specified by the manufacturer, its safety may be impaired.
- Prior to setting the thermostat, it is necessary to complete all required settings described in this section.
- Before commencing installation, the thermostat must be first disconnected from the mains.

This thermostat can be mounted in the following ways:

- 1) Directly mounted on wall**
- 2) To a surface mounting box**

Mounting & Installation Continued

- 1) Remove the thermostat from its packaging.
- 2) Choose a mounting location so that the thermostat can measure the room temperature as accurately as possible.
 - Mount the thermostat 1.5 meters above the floor level.
 - Prevent direct exposure to sunlight or other heating / cooling sources.
- 3) Use a philips screwdriver to loosen the screw on the bottom of the thermostat to open the front housing.
- 4) Wire the thermostat according to the wiring diagram on page 6.
- 5) Screw the backplate onto a back box or directly to the surface.
- 6) Close the front housing and tighten the screw on the bottom of the thermostat.


1

UK
CA



CE

Type
1C
EN60730IP20
EN60529


2




3




4



5




6





Mains RF Room Thermostat
Operating Instructions

On / Off Function


Press  to turn the thermostat On or Off.

When OFF is displayed on the screen the thermostat and zone will be set to OFF.


Note: If the zone is in the constant OFF mode and the ON/OFF button is pressed, this will change the mode of the zone to constant ON.

Adjusting the Target Temperature



Press  to increase the target temperature from 5-35°C.


Press  or wait 5 seconds. The target temperature is now saved.


Press  to decrease the target temperature from 5-35°C.


Press  or wait 5 seconds. The target temperature is now saved.

Locking the Keypad

To lock the thermostat, press and hold  and  for 10 seconds.

 will appear on the screen. The buttons are now disabled.

To unlock the thermostat, press and hold  and  for 10 seconds.

 will disappear from the screen. The buttons are now enabled.


Backlight AUTO

There are three settings for selection.

'AUT' The backlight is on for 5 seconds when any button is pressed.

'OFF' The backlight is permanently off.

'ON' The backlight is permanently on.

To adjust the backlight setting, press and hold  for 10 seconds. 'AUT' appears on the screen.

Use  and  to change the mode between AUTO, ON and OFF.

Press  to confirm selection and to return to normal operation.

Menu

This menu allows the user to adjust additional functions.


Press and hold  and  together for 5 seconds to access the menu.


P0 1 Connecting a CDT2-RF


This function allows the user to connect a CDT2-RF to a UFH10-RF or a R_7-RF^{v2} programmer.


To connect a CDT2-RF to a UFH10-RF

1. On the UFH10-RF:

Press , 'P01 rF COn' will appear on the screen.

Press , 'RF CONNECT' will appear solid on the screen.

Rotate  to choose the zone you would like to connect to.


Press  to confirm. The zone will stop flashing and appear solid.

2. On the CDT2-RF:



Press and hold  and  buttons together for 5 seconds.
'P01' will appear on the screen.

Press  to select.

Wait for 'r01' to appear solid.

Press  to confirm the thermostat is connected.


3. On the UFH10-RF:


Rotate  to choose another zone you would like to connect to or press  twice to return to normal operation.

Note: When pairing additional zones to a UFH10-RF, 'r02', 'r03', 'r04' ...'r10' can appear on the thermostat screen.


To connect a CDT2-RF to a R_7-RF^{V2}

1. On the R_7-RF^{V2}:

Press , 'P01 rF COn' will appear on the screen.

Press , 'RF CONNECT' will appear solid on the screen.

2. On the CDT2-RF:

Press and hold the  and  buttons together for 5 seconds. 'P01' will appear on the screen.


Press  to confirm.

3. On the R_7-RF^{V2}:

Once 'ZONE' flashes, press  on the desired zone.


4. On the CDT2-RF:

Wait for 'r01' to appear.

Press  to confirm the thermostat is connected.

*If there are multiple CDT2-RF thermostats to be connected, repeat steps 2, 3 and 4.

5. On the R_7-RF^{V2}:

Press  to return to the main screen when thermostat pairing is complete.

Note: When pairing additional zones to an R_7-RF^{V2}, 'r02', 'r03', 'r04' can appear on the thermostat screen.

P0 2 Operating Mode (Normal / Delay Start / TPI)

There are three settings for selection, Normal, Delay Start or TPI mode. The default setting is Normal.

Press and hold  and  together for 5 seconds.

'P01' will appear on the screen.

Press  until 'P02' appears on the screen.

Press  to select.


Use  and  to select between:

nOr (Normal mode)

dS (Delay Start mode)

tPi (Time Proportional Integral mode)

Press  to confirm the mode.


Press  to return to the home screen.

P0 2 Operating Mode continued

Nor (Normal Mode)

When the temperature falls below the target temperature, 🔥 will appear and the thermostat will activate the demand for heat.

When the temperature rises above the target temperature, 🔥 will disappear, and the thermostat will cancel the demand for heat.

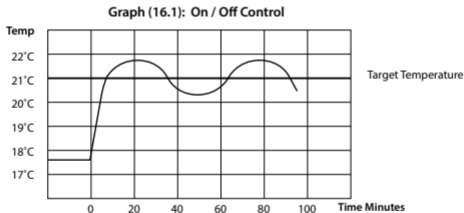


Delay Start Control (On/Off)

When in this mode the thermostat is delayed by a variable time depending on the current temperature, target temperature and also the fall in temperature from when the delay start has activated.

The 🔥 will flash until the thermostat activates.

When activated the thermostat will allow the heating system time to reach the target and delay start will remain inactive until it reaches this target.

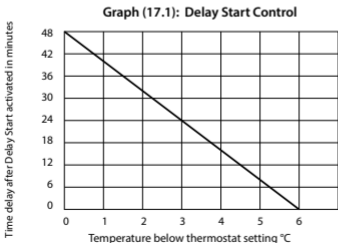

E.g: If the temperature is 6°C below the thermostat target, the thermostat will call for heat immediately.

If the temperature is 2°C below the target, the thermostat will not call for heat for 32 minutes.

P0 2 Operating Mode continued

Delay start can be reactivated by:

1. Press to lower the target below the current temperature.
2. Press to confirm.
3. Press to increase the target temperature above the zone temperature within 6°C .
4. Press to confirm.

The heating will be delayed as per the graph on page 17.

If the difference between the actual temperature and the target is 1°C the thermostat will delay starting for circa 40 minutes.

If the difference between the actual temperature and the target is 3°C the thermostat will delay starting for circa 24 minutes.

If the difference is 6°C or more then the thermostat will be switched on immediately.

The time delay will change if the temperature drops from the original calculation.

Time Proportional Integral Mode (TPI)

When the thermostat is in TPI mode and the temperature is rising in the zone and falls into the Proportional Bandwidth section, TPI will start to affect the thermostats operation. The thermostat will turn on and off as it gains heat so that it doesn't overshoot the target by too much. It will also turn on if the temperature is falling so it doesn't undershoot the target which will leave the user with a more comfortable level of heat.

There are 2 settings that will affect the thermostats operation.

1. The number of heating cycles per hour.
2. The Proportional Bandwidth.

CyC – Number of Heating Cycles per hour  **6 Cycles**

This value will decide how often the thermostat will cycle the heating on and off when trying to achieve the target temperature. You can select 2, 3, 6 or 12.


P0 2 Operating Mode continued

Time Proportional Integral Mode (TPI)

Pb -Proportional Bandwidth 2°C

This value refers to the temperature below the target at which the thermostat will start to operate in TPI control. You can set this temperature from 1.5°C to 3.0°C in 0.1°C increments.

Graph (20.1): TPI Control

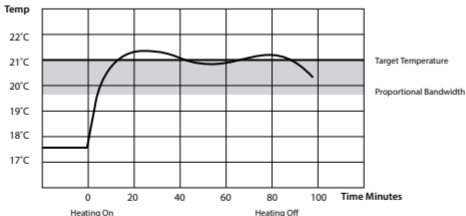



Time Proportional Integral Mode (TPI)

Once TPI mode is selected, 'CYC' and '06' will appear on the screen.


Use  and  to select from 2, 3, 6 or 12.

Press  to confirm.

'P Band' and '2.0' will appear on the screen.

Use  and  to select from 1.5 to 3.0.

Press  to confirm.

Press  to return to normal operation.

P0 3 Setting High and Low limits OFF

This menu allows the installer to change the minimum and maximum temperatures that the thermostat can be set to between 5...35°C


Press and hold  and  together for 5 seconds.

'P01' will appear on the screen.


Press  until 'P03 & LIMIT' appears on the screen.


Press  to select.

Use  and  to select 'ON'.


Press  to select. 'HIGH LIMIT' will appear on the screen, the temperature will begin to flash.

Use  and  to select the high limit for the thermostat.

Press  to confirm. 'LOW LIMIT' will appear on the screen, the temperature will begin to flash.

Use  and  to select the low limit for the thermostat.

Press  to confirm.

Press  to return to normal operation.

'LIMIT' will appear on the screen.

P0 4 HYS - Hysteresis HOn 0.4°C HOF 0°C

This menu allows the installer to change the switching differential of the thermostat when the temperature is rising and falling.


If 'HYS ON' is set at 0.4°C and the setpoint is 20°C, then the thermostat will switch on when the temperature drops below 19.6°C.


If 'HYS OFF' is set at 0.2°C and the setpoint is 20°C, then the thermostat will switch off when the temperature reaches 20.2°C.




Press and hold  and  together for 5 seconds.

'P01' will appear on the screen.

Press  until 'P04 & HYS' appears on the screen.




Press  to select. 'HOn' will appear on the screen.


Press  and temperature will begin to flash.

Use  and  to select the 'HOn' temperature, press .

'HOF' appears on the screen.

Press  and the temperature will begin to flash.

Use  and  to select the 'HOF' temperature, press .

Press  to return to normal operation.

P0 5 Calibrate

This menu allows the installer to calibrate the temperature of the thermostat.

Press and hold  and  together for 5 seconds.

'P01' will appear on the screen.


Press  until 'P05 & CALIBRATE' appears on the screen.

Press  to select.

The actual temperature will flash on the screen.

Use  and  to calibrate the temperature.

Press  to confirm the temperature.

Press  to return to normal operation.

P0 6 Setback Mode (0°C / Off)

In Setback mode, the thermostat reduces the temperature setpoint by 0°...10°C which is predetermined by the user. The factory default setting is set to (0°C / OFF) and needs to be activated to function. Setback mode will only work when the zone is timed off. This can only happen when the zone is in the AUTO OFF or ALL DAY OFF mode.

Press and hold  and  together for 5 seconds.

'P01' will appear on the screen.

Press  until 'P06 & SET' appears on the screen.

Press  to select. 'OFF' will appear on the screen.


Use  and  to select 'On'.

Press  to confirm.

The setback temperature will begin flashing on the screen.

Use  and  to select setback temperature between 0°...10°C..

Press  to confirm.

Press  to return to normal operation.

The setback temperature will be saved, and the user will be returned to the previous screen.

When in Setback mode 'LOW' will appear on the screen.



P0 7 AFS - Air / Floor Sensor (01 Internal air sensor)

This function allows the user to select between 3 different temperature sensor options.

01 Internal air sensor – This option allows the user to record the room temperature using the internal sensor. This is the default option.


02 External air sensor – This option allows the user to record the temperature of an adjacent room. (**NTC10K temperature sensor required**).

03 Internal air sensor with an external high limit sensor. – This option allows the user to record the room temperature with the internal sensor while having the external sensor record the floor temperature to prevent overheating. (**NTC10K temperature sensor required**).



Press and hold  and  buttons together for 5 seconds.

'P01' will appear on the screen.


Press  until 'P07' appears on the screen.

Press  to select.

'01' will flash on the screen.

Use  and  to choose between options 01, 02 or 03.

Press  to confirm.

Press  to return to normal operation.

Note: NTC10K temperature sensor can be bought separately as an accessory.


P08 FHL - Floor High Limit 26°C

This function allows the user to select the high limit temperature of the external sensor. Selectable temperature range 5...45°C.

Temperature Sensor 03 must be selected, See Page 26 P07 AFS.



Press and hold the  and  together for 5 seconds.


'P01' will appear on the screen.


Press  until 'P08' appears on the screen.

Press  to select.


The high limit temperature will flash on the screen.

Use  and  to choose the desired high limit temperature.

Press  confirm the temperature.

Press  to return to normal operation.

Resetting the Thermostat

To reset the thermostat to factory settings, locate the  reset button on the left hand side of the thermostat.

Press the  reset button and release it.

'NO' will flash on the screen.

Press .

'YES' will flash on the screen.

Press  to confirm.

The thermostat will restart and revert to its factory settings.

EPH Controls IE

technical@ephcontrols.com

www.ephcontrols.com/contact-us

+353 21 471 8440

Cork, T12 W665



EPH Controls UK

technical@ephcontrols.co.uk

www.ephcontrols.co.uk/contact-us

+44 1933 322 072

Harrow, HA1 1BD

